


INFORMATION ONLY



NOTE: Hearth & Wall Tiles CUT AND INSTALLED by others

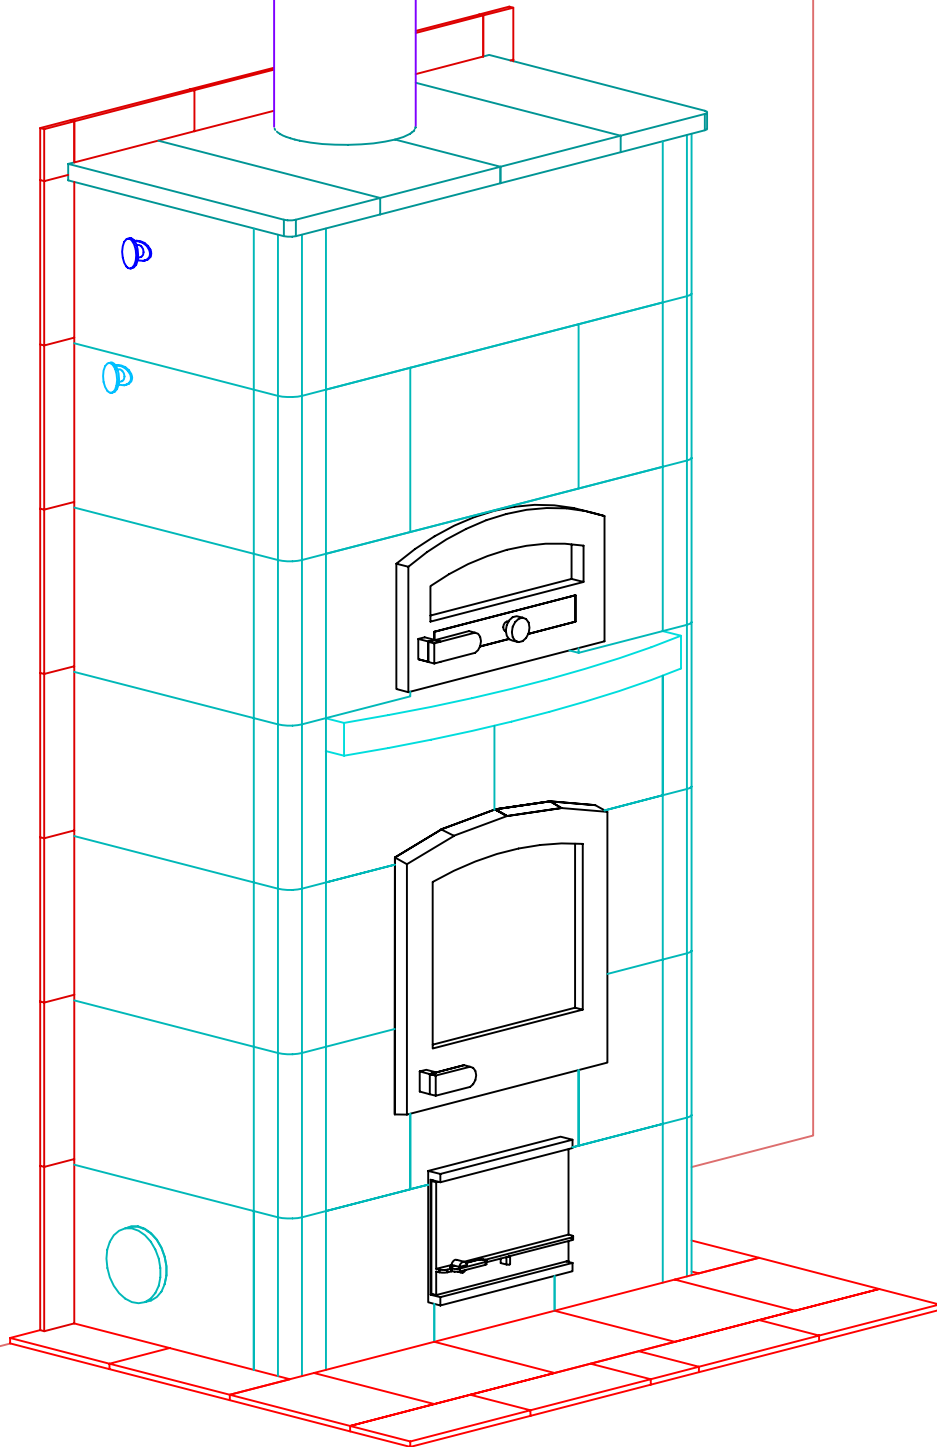

DIXIE LOG HOMES
515 Meece Bridge Road
Taylors, SC 29687
(800)940-6578 Fax 864-244-7420


PROJECT CHAPMAN
MODEL TTU2700/5

CONTRACT
DRAWN BY D.P.BYRAM

VIEW PERSPECTIVE
DATE 5/30/03

PAGE 1

INFORMATION ONLY

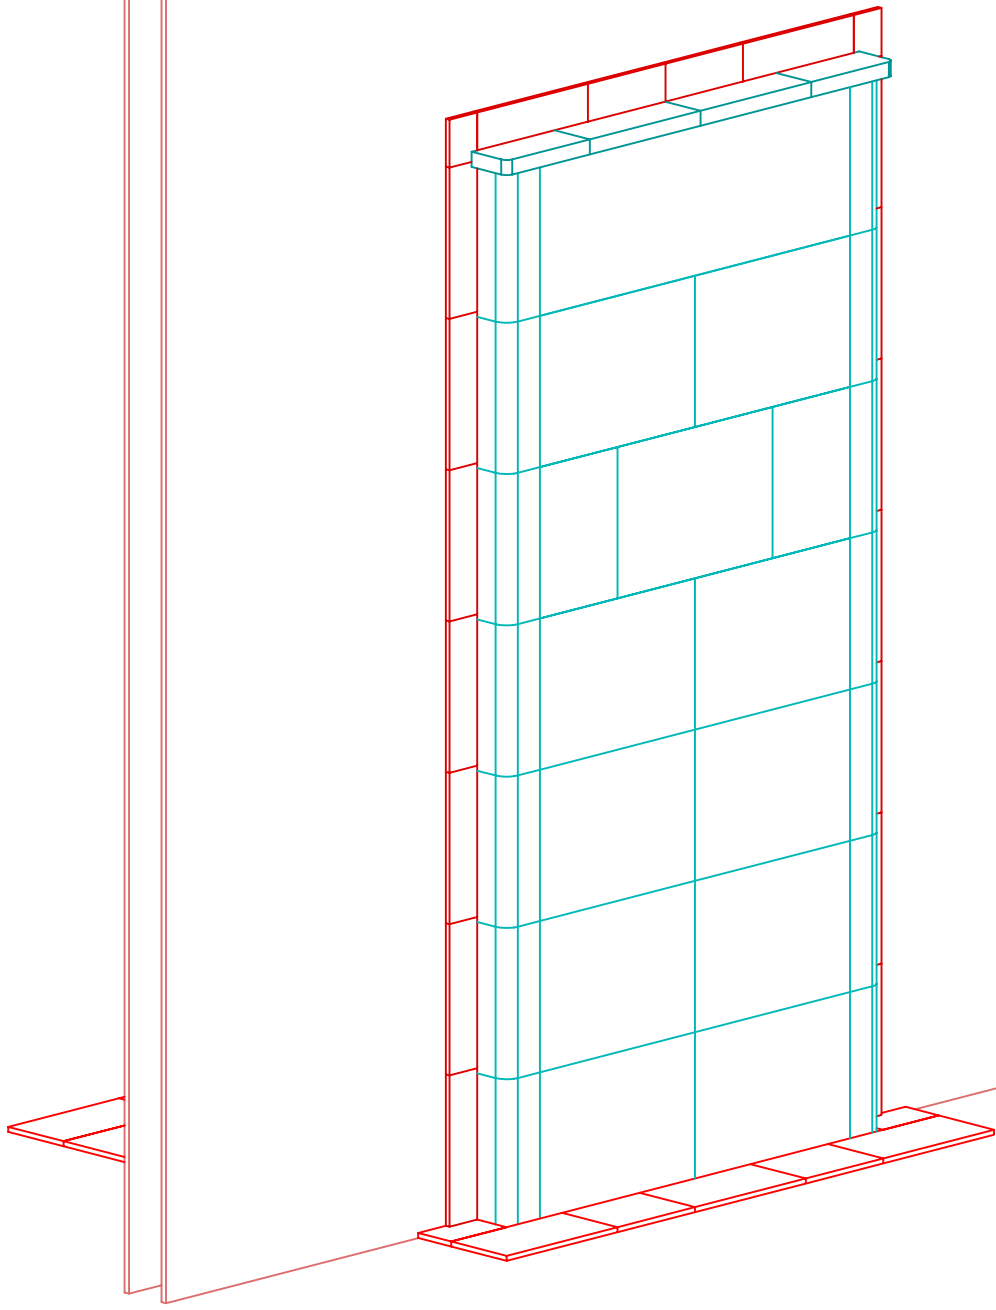


NOTE: Hearth & Wall Tiles CUT AND INSTALLED by others

INFORMATION ONLY

FRONT VIEW

8" I.D./10" O.D. Double Wall
Stainless Steel Flue
Pipe by others.
MINIMUM 2" clearance
to Combustibles.
See page 5 for Detail.

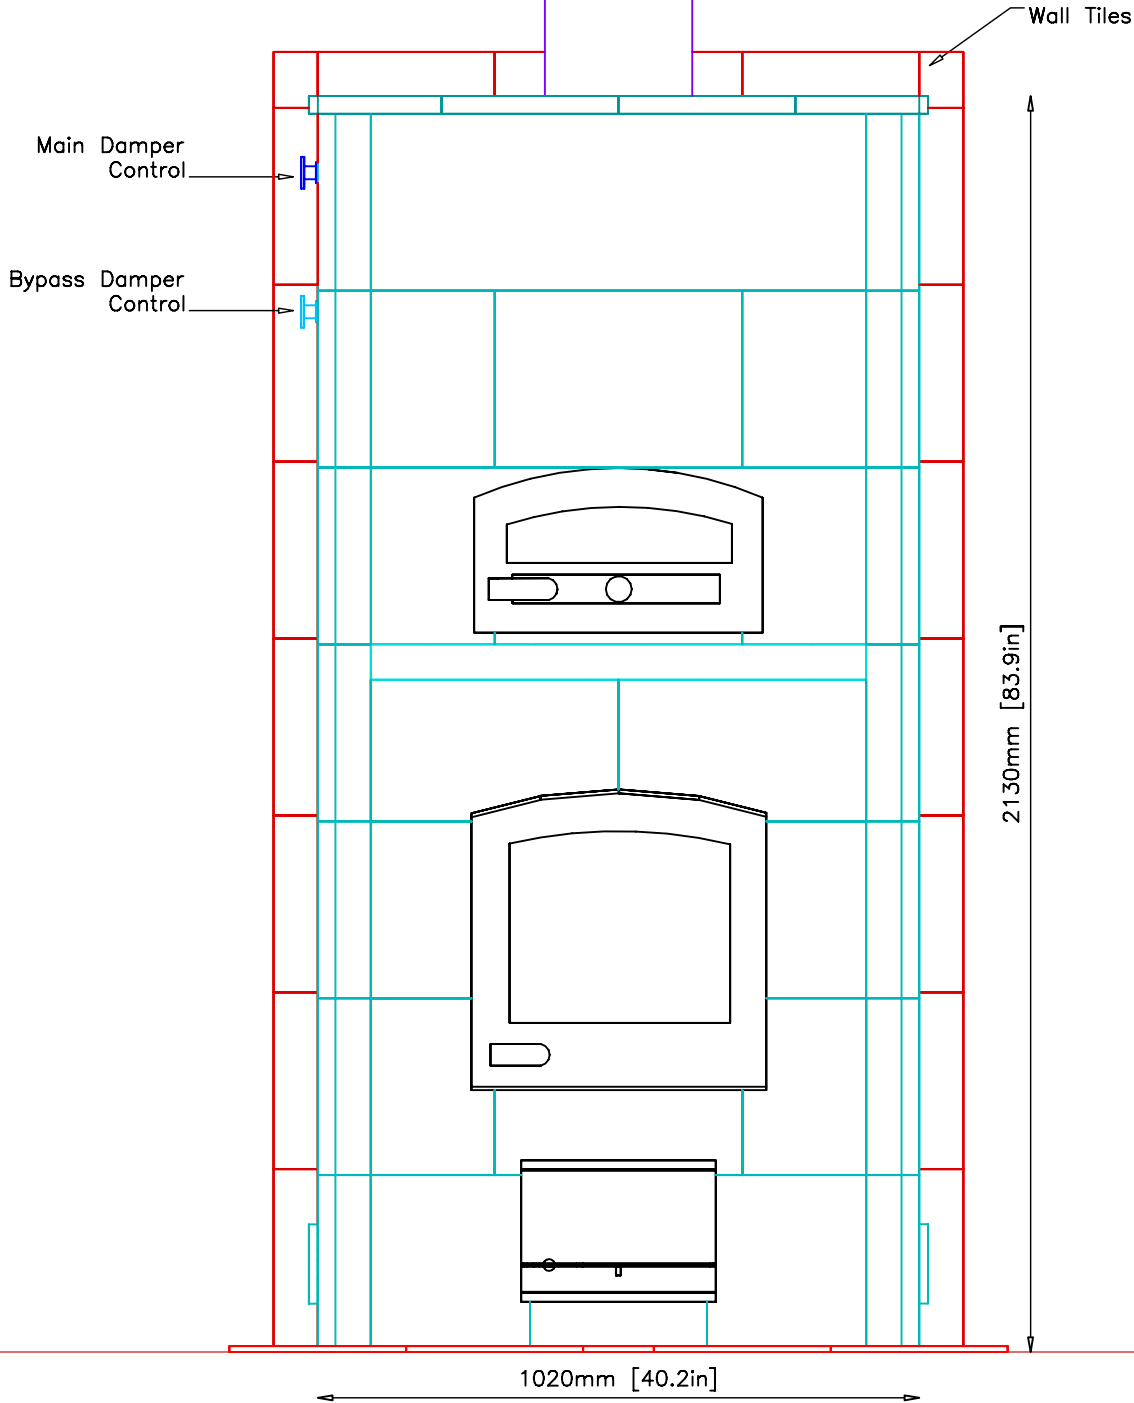

NOTE: Hearth & Wall Tiles CUT AND INSTALLED by others



DIXIE LOG HOMES
515 Meece Bridge Road
Taylors, SC 29687
(800)940-6578 Fax 864-244-7420

PROJECT CHAPMAN
MODEL TTU2700/5

CONTRACT
DRAWN BY D.P.BYRAM


VIEW FRONT
DATE 5/30/03

PAGE 3

SIDE VIEW

8" I.D./10" O.D. Double Wall
Stainless Steel
Flue Pipe by others.
MINIMUM 2" Clearance
to Combustibles.
See page 5 for Detail.

INFORMATION ONLY

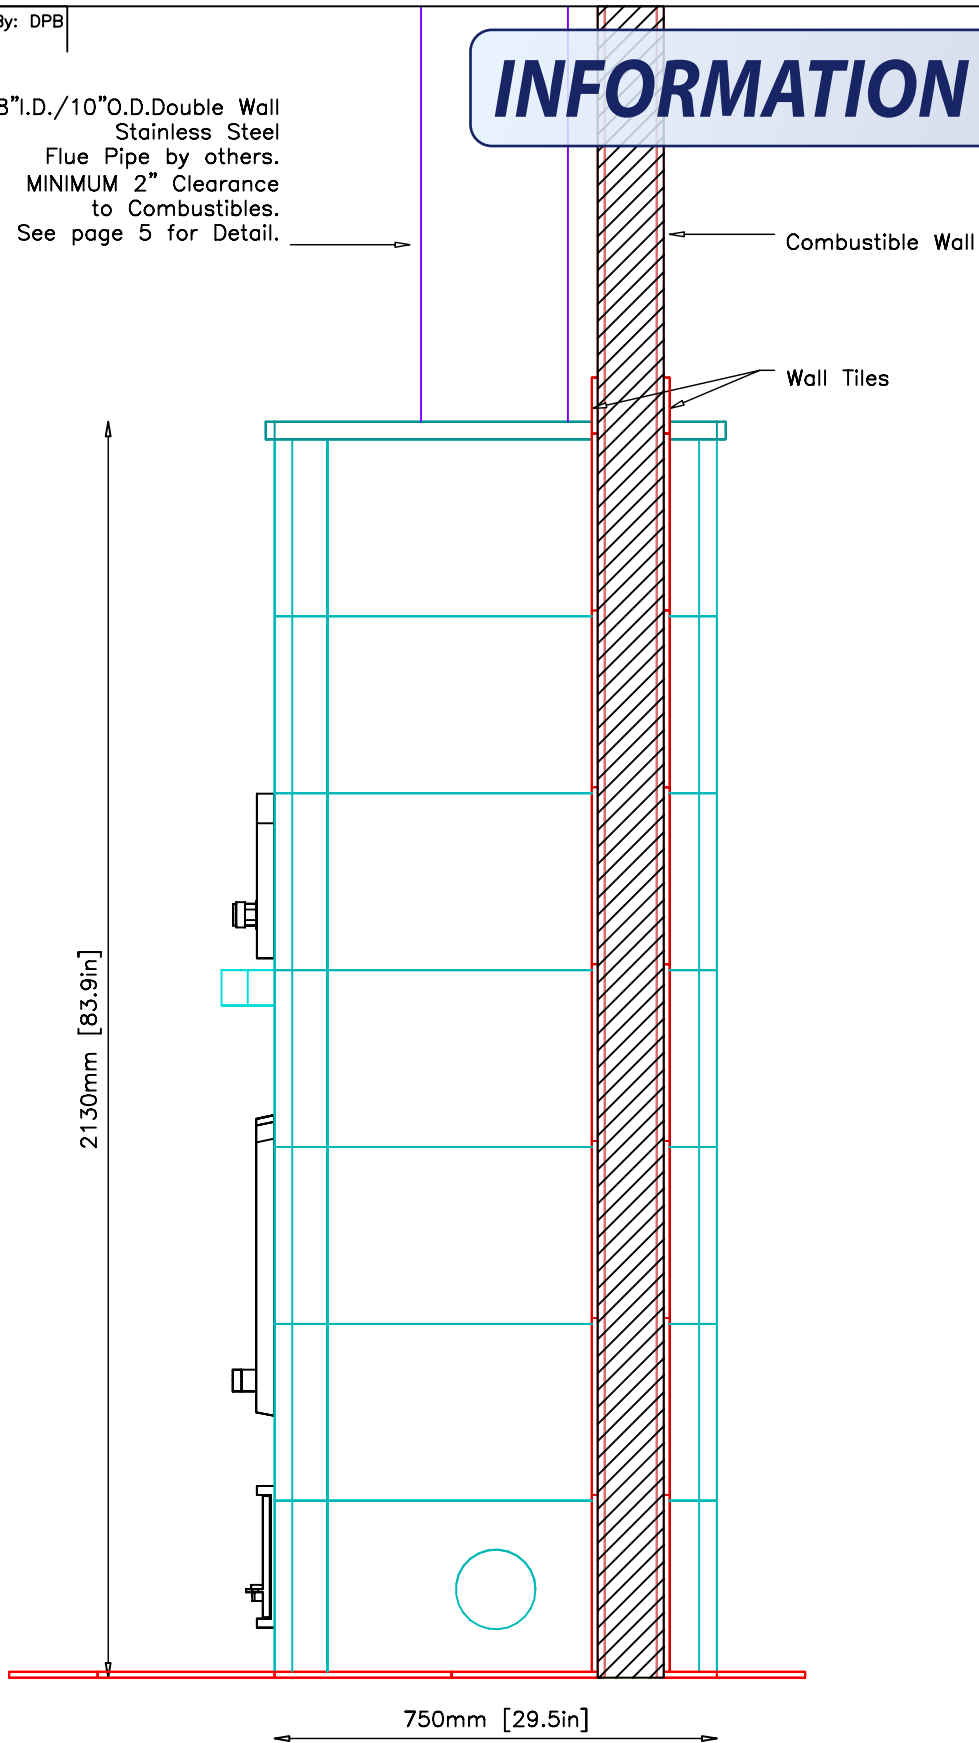

NOTE: Hearth & Wall Tiles CUT AND INSTALLED by others



DIXIE LOG HOMES
515 Meece Bridge Road
Taylors, SC 29687
(800)940-6578 Fax 864-244-7420

PROJECT CHAPMAN
MODEL TLU2000/1


CONTRACT
DRAWN BY D.P.BYRAM

VIEW SIDE
DATE 5/30/03

PAGE

4

PLAN VIEW

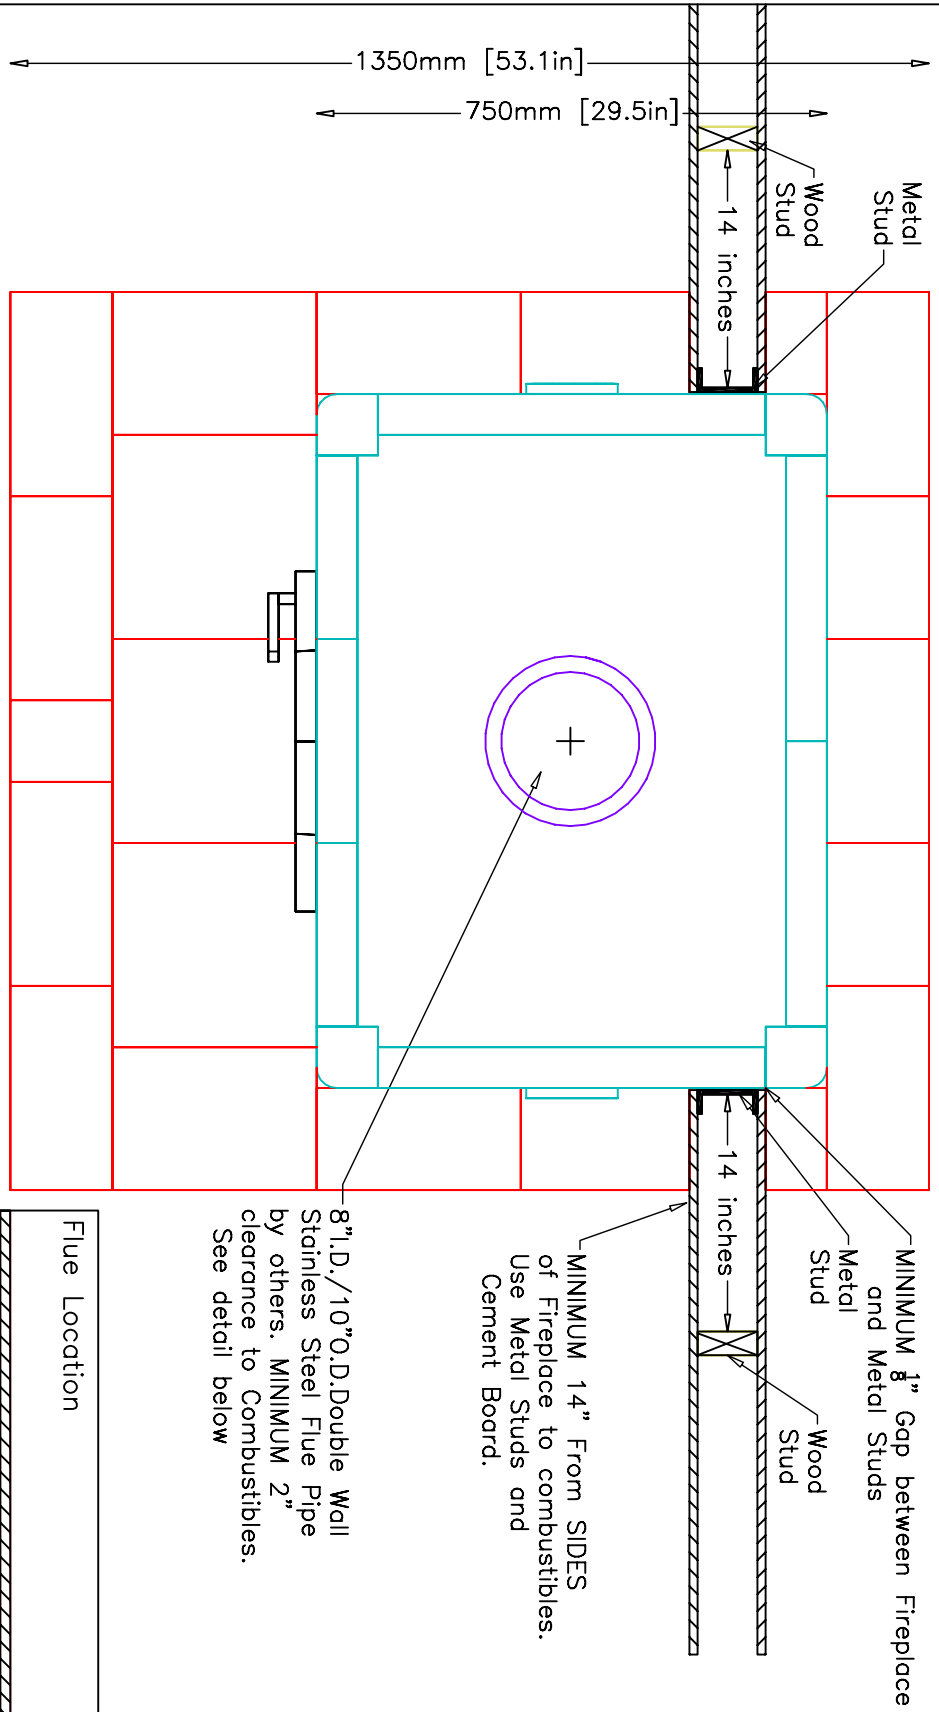


8" I.D./10" O.D. Double Wall Stainless Steel Flue Pipe by others. MINIMUM 2" clearance to combustibles. See detail below

MINIMUM 14" From SIDES of Fireplace to combustibles. Use Metal Studs and Cement Board.

MINIMUM 8" Gap between Fireplace and Metal Studs

NOTE: Hearth & Wall Tiles CUT AND INSTALLED by others

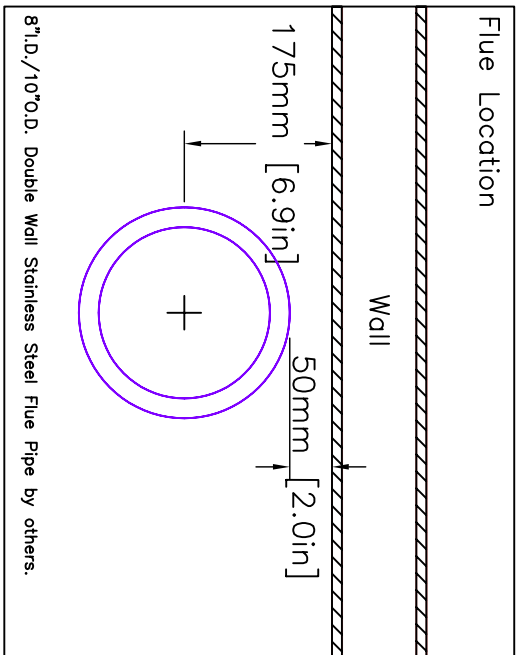


INFORMATION ONLY

INFORMATION ONLY

FOUNDATION SLAB

Minimum Dimensions--2" from Base of Unit

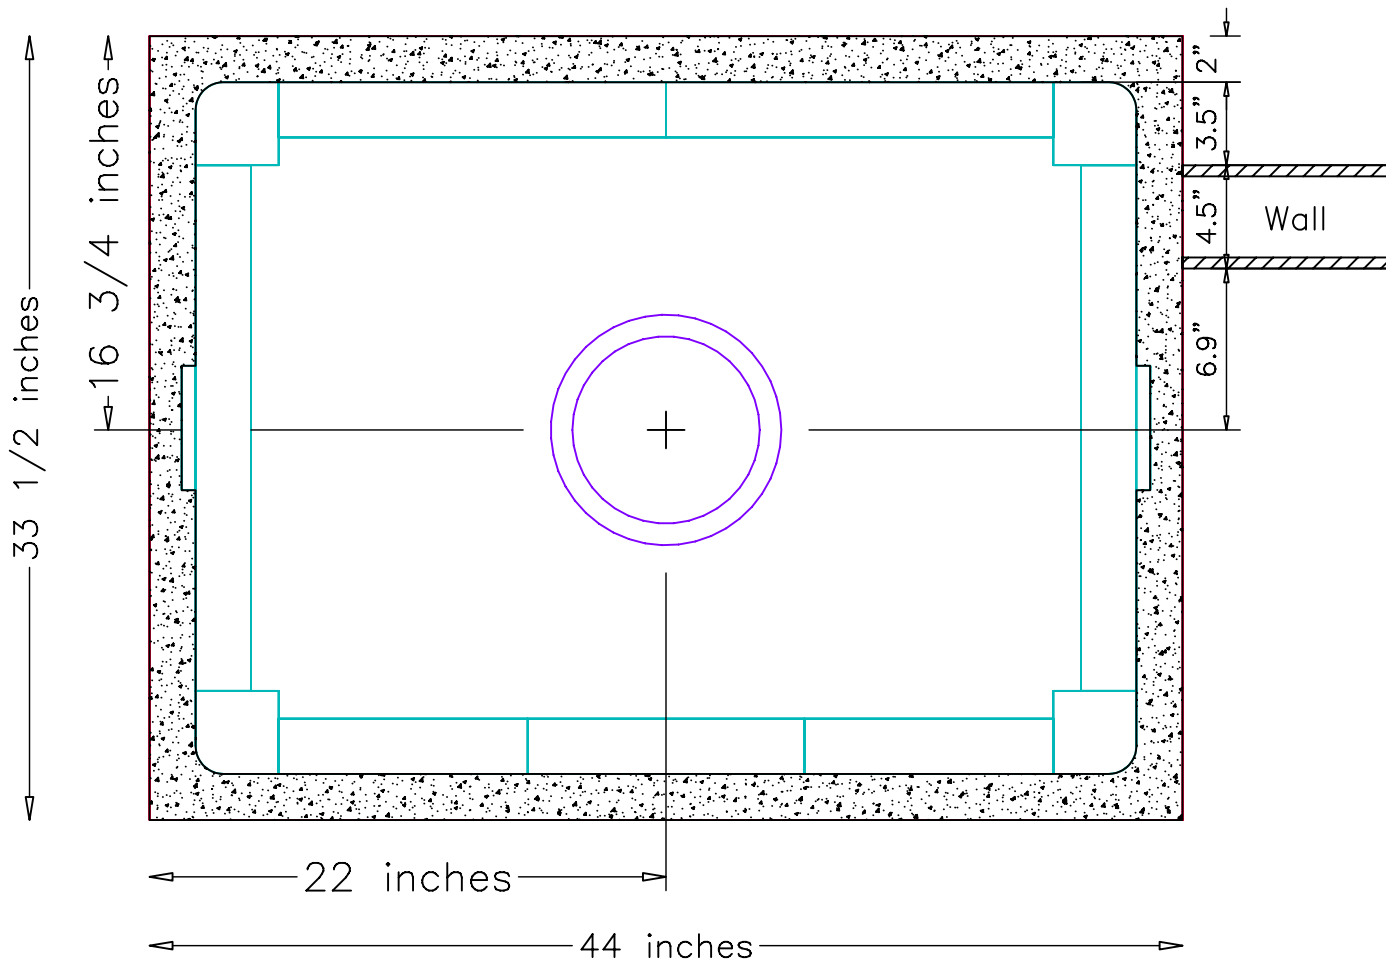

FLUE LOCATION:

From Upper Left Corner of Foundation Slab:
16 ³/₄" x 22" to CENTER of Flue Pipe.

NOTE:

TOP OF FOUNDATION SLAB TO BE LEVEL
AND FLUSH WITH SUB-FLOOR


Tolerances:

- +/- 1/8" No additional cost to adjust slab
- +/- 1/4" \$150.00-\$200.00 additional cost to adjust slab
- +/- 1/2" \$500.00 additional cost to adjust slab

UNIT WEIGHT: MINIMUM 7000lbs.

Contractor is responsible for engineering foundation slab to support weight of fireplace.

FOUNDATION SLAB:
 * MINIMUM 4" THICK
 WITH REBAR 6"O.C.
 * NONCOMBUSTIBLE
 CEMENT BOARD
 under foundation slab
 (NOT PLYWOOD)

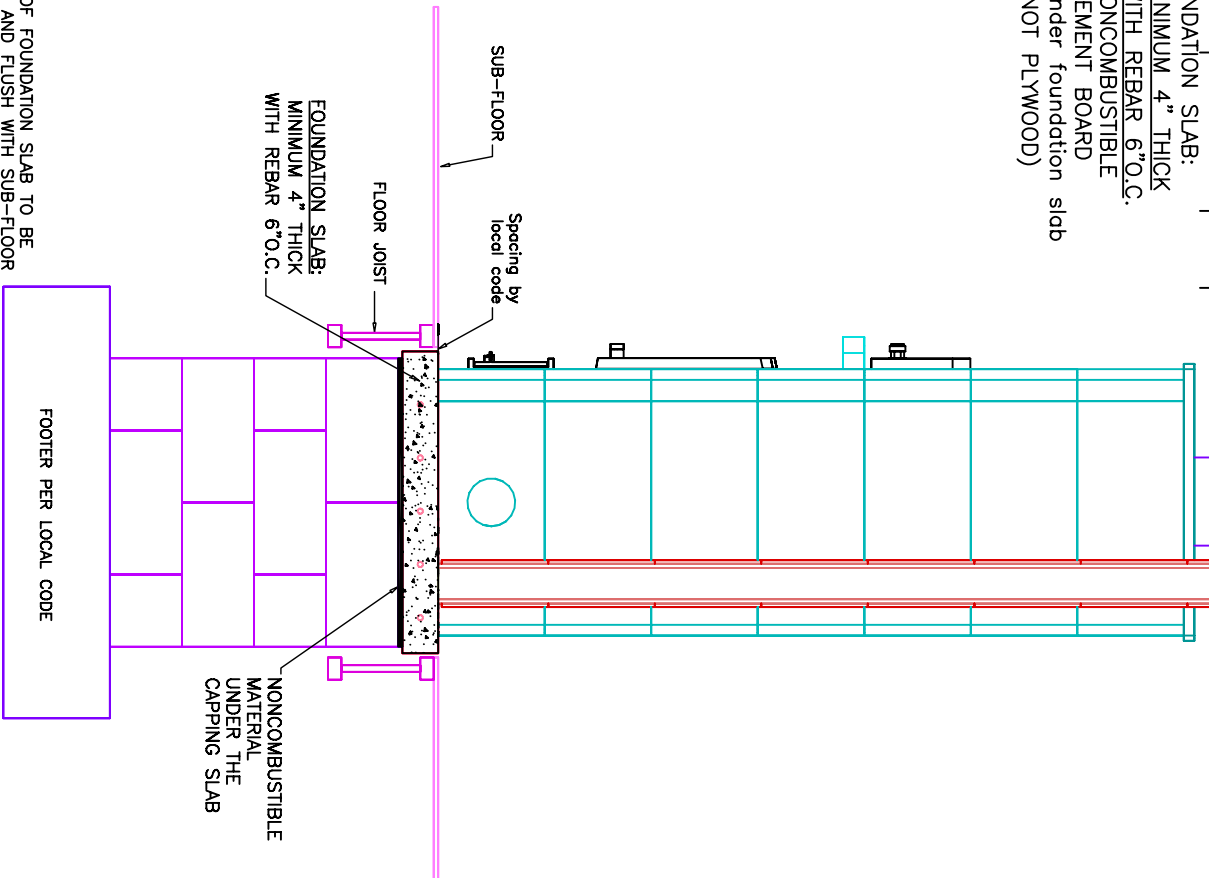


NOTE:
 TOP OF FOUNDATION SLAB TO BE
 LEVEL AND FLUSH WITH SUB-FLOOR
 Tolerances:

- +/- 1/8" No additional cost to adjust slab
- +/- 1/4" \$150.00-\$200.00 additional cost to adjust slab
- +/- 1/2" \$500.00 additional cost to adjust slab

UNIT WEIGHT: Approx. 7000lbs.

Contractor is responsible for engineering foundation slab to support weight of fireplace.

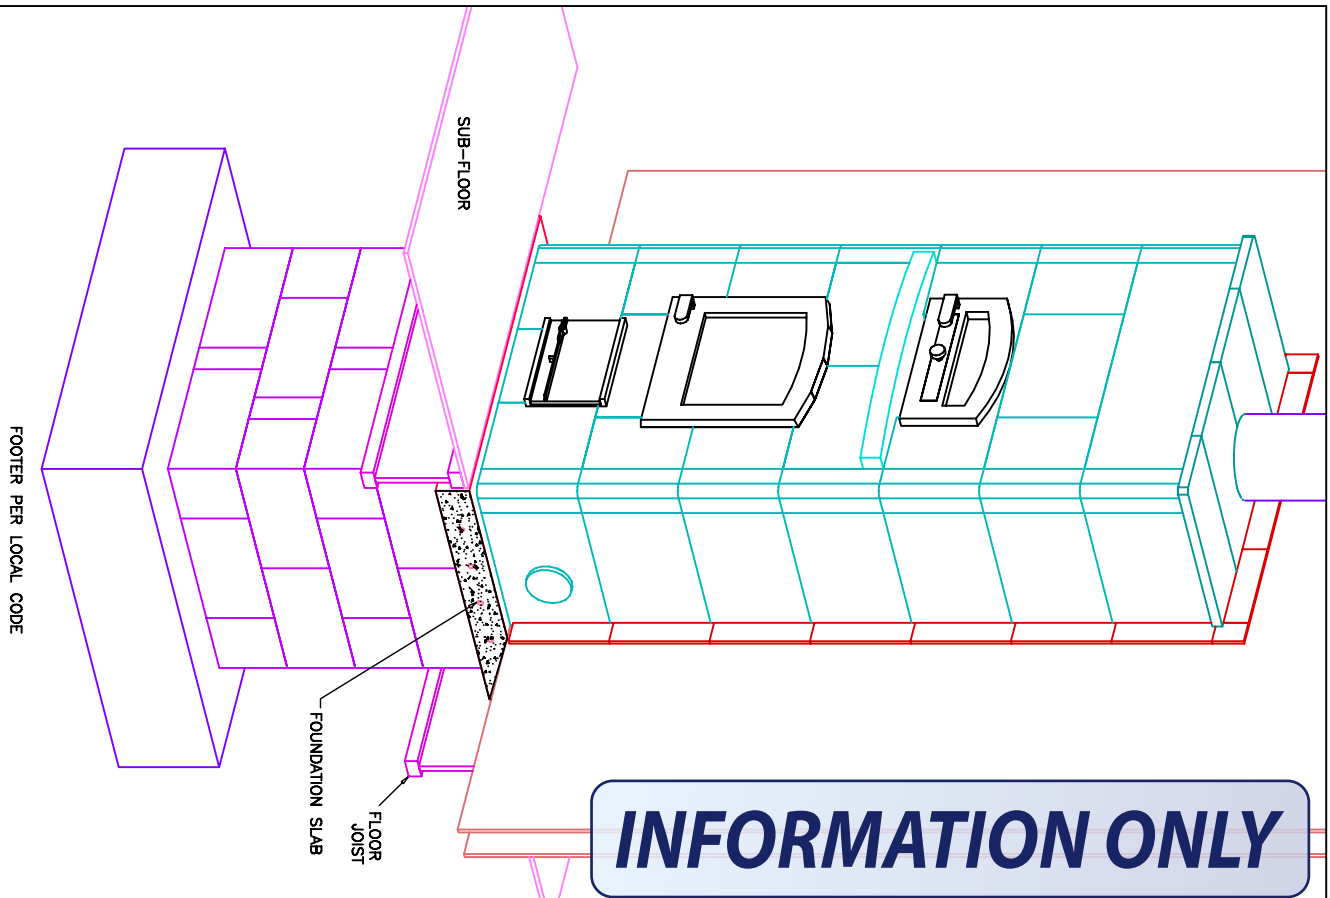


DIXIE LOG HOMES
 515 Meece Bridge Road
 Taylors, SC 29687
 (800)940-6578 Fax 864-244-7420


PROJECT	CHAPMAN	CONTRACT	VIEW	Support
MODEL	TTU2700/5	DRAWN BY	DATE	5/30/03
		D.P. BYRAM		

PAGE 7

Wall Detail

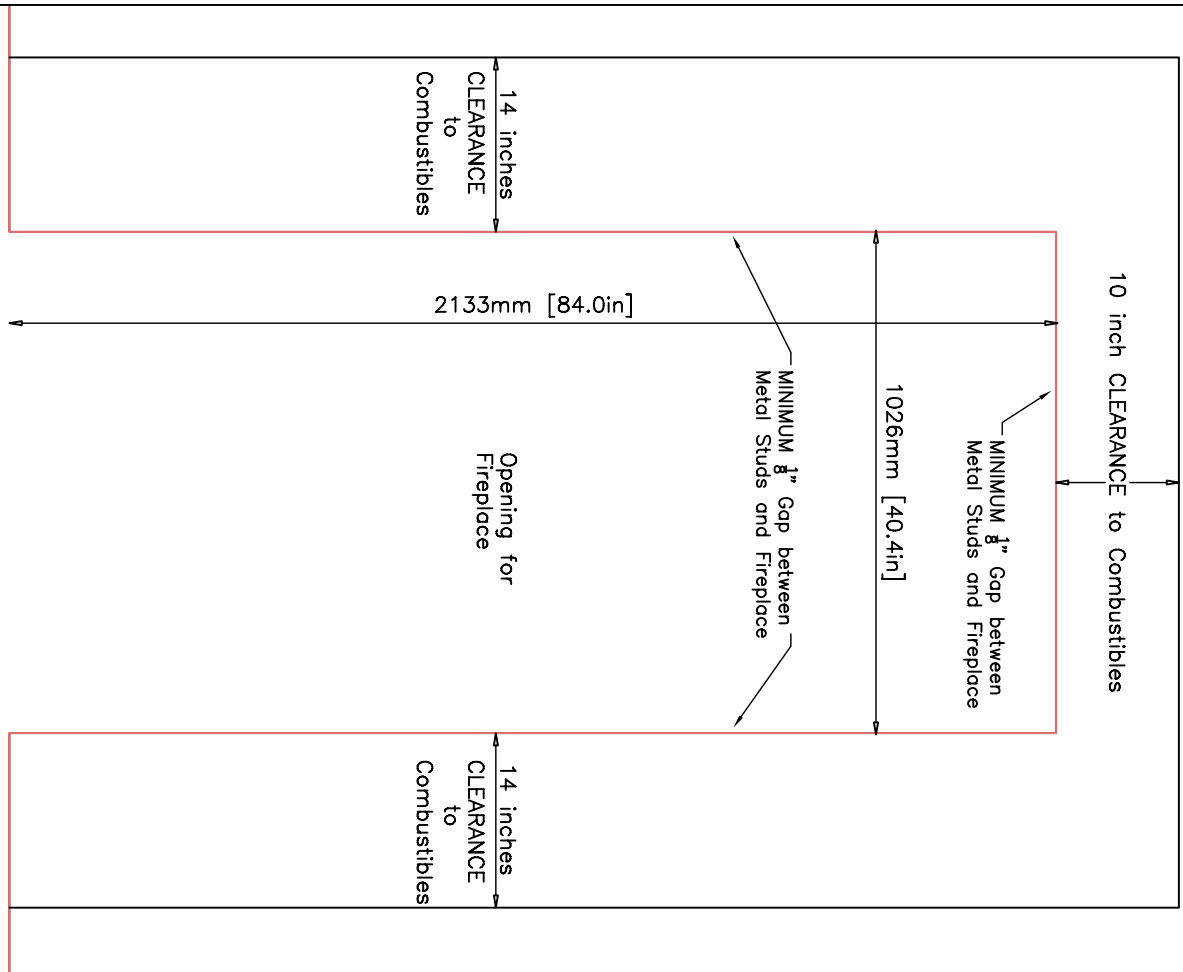

Clearances to Combustible Materials:
 MINIMUM 10" Clearance to Combustible Material from TOP of Fireplace.
 MINIMUM 14" Clearance to Combustible Material from SIDES of Fireplace.
 Use Metal Studs and Cement Board.

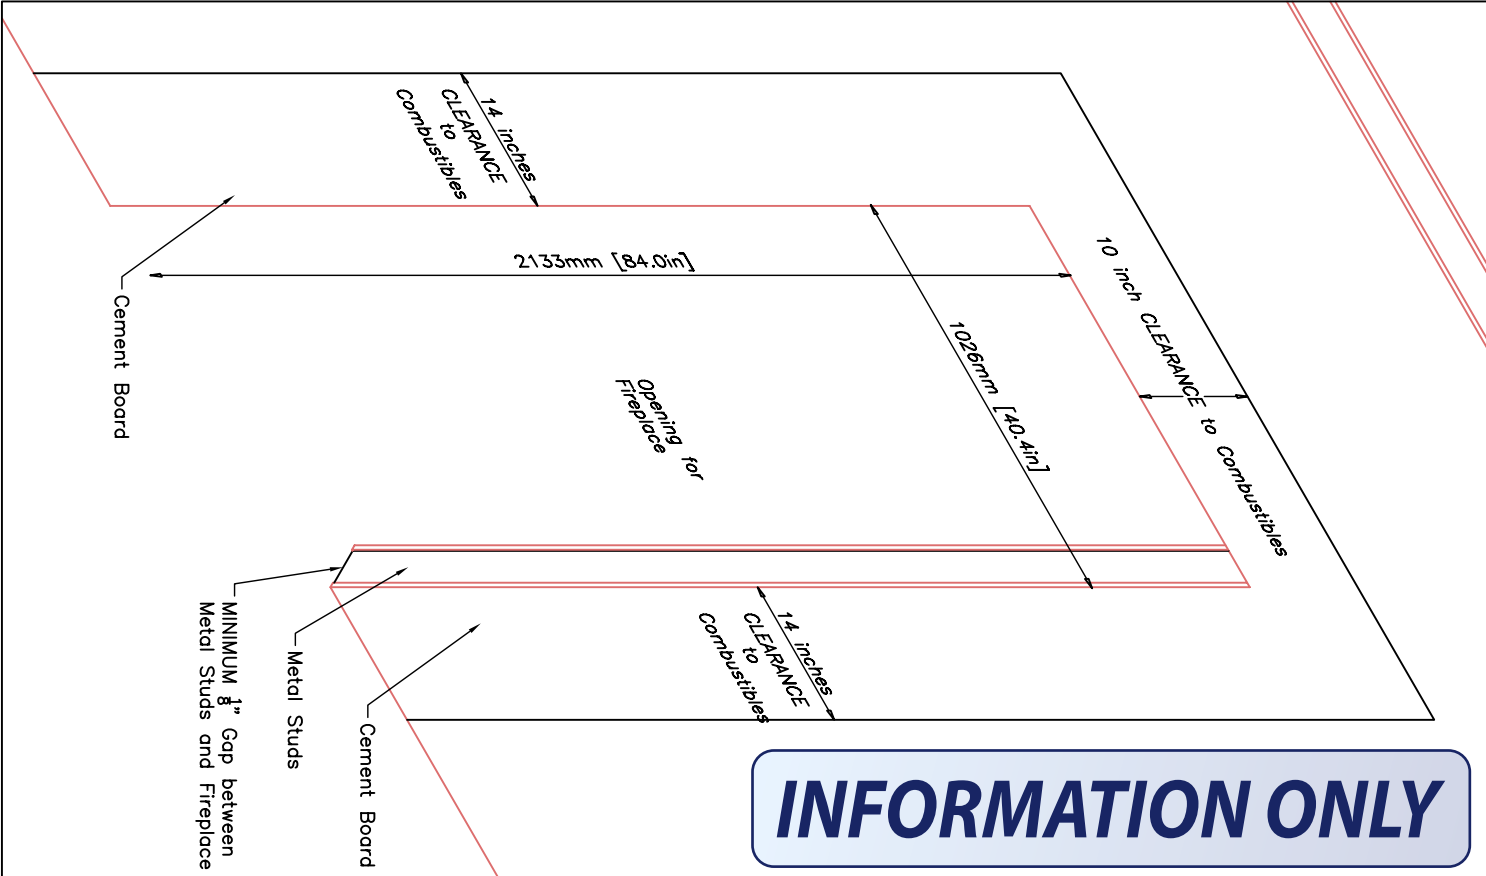

INFORMATION ONLY